


TABLE 1					
SERVICE LINE SIZE	MINIMUM METER BOX SIZE	BOX MODEL	LID / FRAME MODEL	COMMENTS	INSULATION INSERTS
1" MINIMUM	18" x 60"	330CS1860FSBS	780113 / 700098	NEW SERVICES	790153
1 1/2"	24" x 60"	500VB2460FBB	780113 / 700098	" "	790325
2"	27" x 60"	550VB2760FBB	780113 / 700098	" "	790327

NOTE 1: FOR LARGER SIZES CONTACT PUBLIC WORKS FOR REQUIREMENTS

NOTE 2: SERVICE LINE SIZE ON TWO-LOT CONNECTION MEASURED FROM TEE TO BALL VALVE

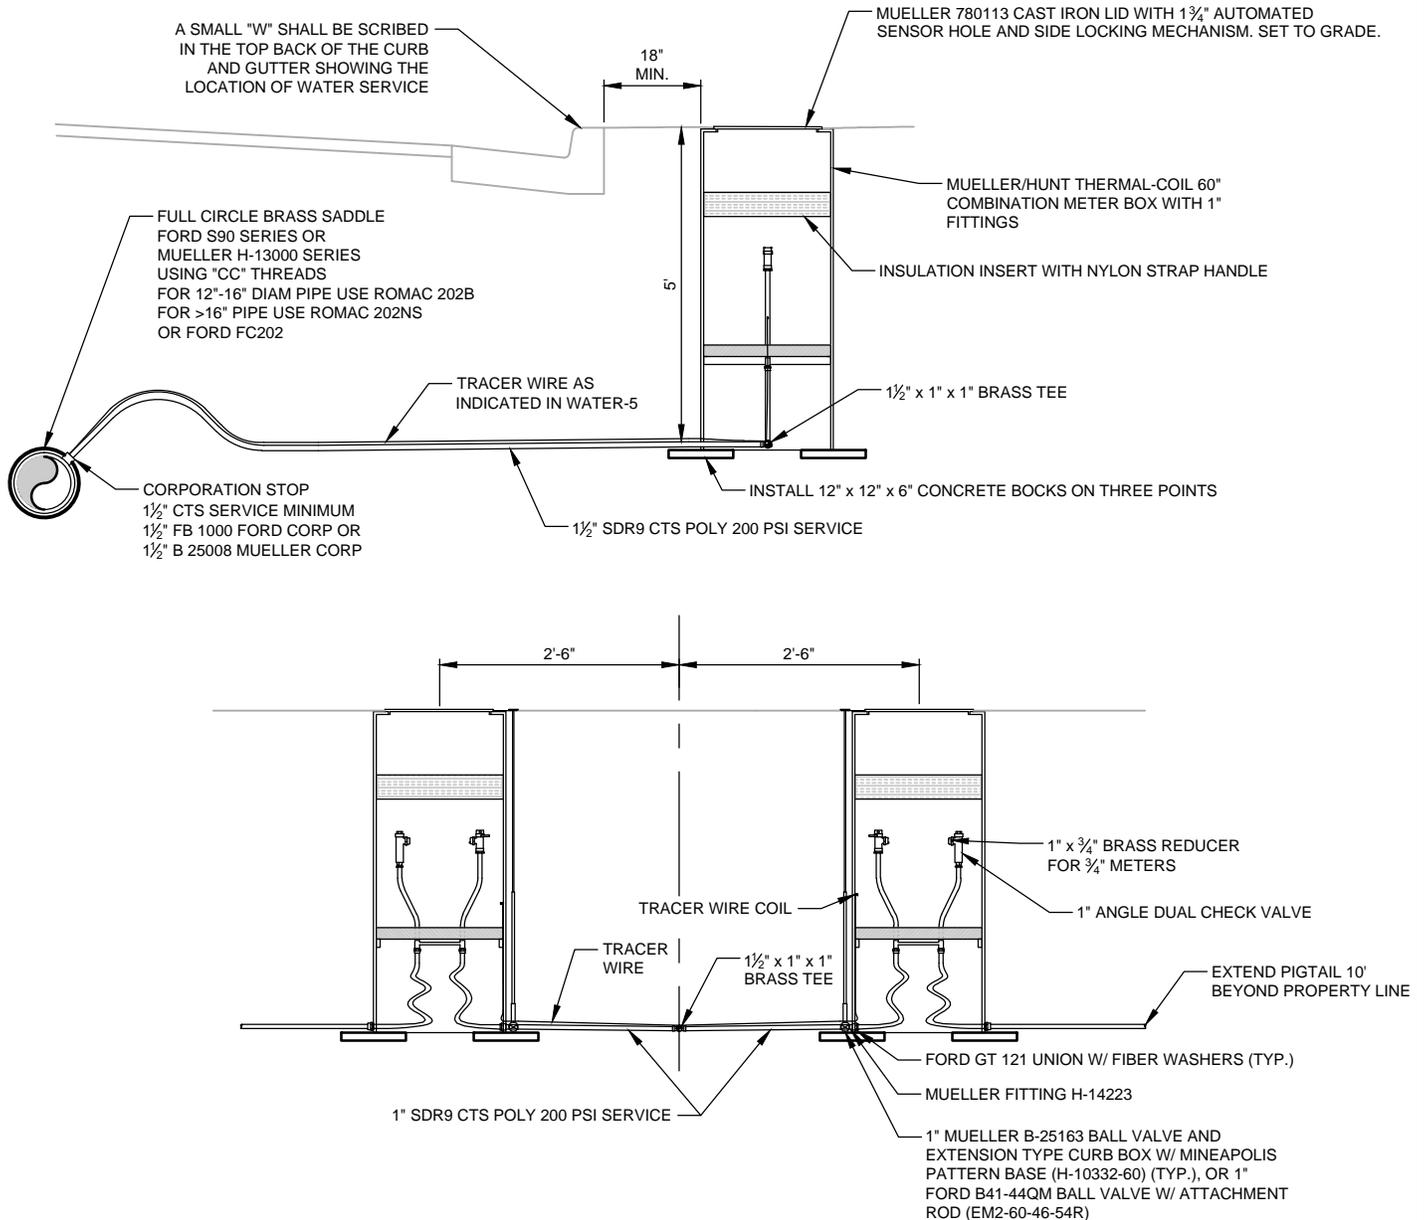

NOTES:

- METER BOX, COVER, COPPER SETTER, CORPORATION STOP, & SERVICE LINES TO BE FURNISHED AND INSTALLED BY DEVELOPER AND CONFORM TO AWWA C800.
- STAINLESS STEEL STIFFENERS ON ALL POLY CONNECTIONS.
- BOXES ARE PROHIBITED IN DRIVEWAYS FOR 1 1/2" AND LARGER.
- WATER METER WILL BE INSTALLED BY HEBER CITY.
- SEE UTILS-3 FOR PLAN VIEW.
- WATER METER CAN TO BE LOCATED IN THE MIDDLE OF THE PLANTER STRIP OR BETWEEN SIDEWALK AND PROPERTY LINE (FOR COMBINATION SIDEWALK) OR AS DIRECTED BY ENGINEER.
- WATER SERVICE SHOULD CONNECT DIRECTLY TO THE MAIN LINE AND NOT "TEE" OFF FIRE HYDRANT LINE OR SERVICE LINES.

03/12

WATER SERVICE – TWO LOTS

N.T.S

HEBER CITY
STANDARD DRAWING
WATER-6A