


TABLE 1					
SERVICE LINE SIZE	MINIMUM METER BOX SIZE	BOX MODEL	FRAME MODEL	COMMENTS	INSULATION INSERTS
1" MINIMUM	18" x 60"	330CS1860FSBS000390N	NA	NEW SERVICES	790153
1 1/2"	24" x 60"	500VS2460FVB000520N	700098-1	"	790325
2"	27" x 60"	550VS2760FVB000520N	700098-1	"	790327

NOTE 1: FOR LARGER SIZES CONTACT PUBLIC WORKS FOR REQUIREMENTS

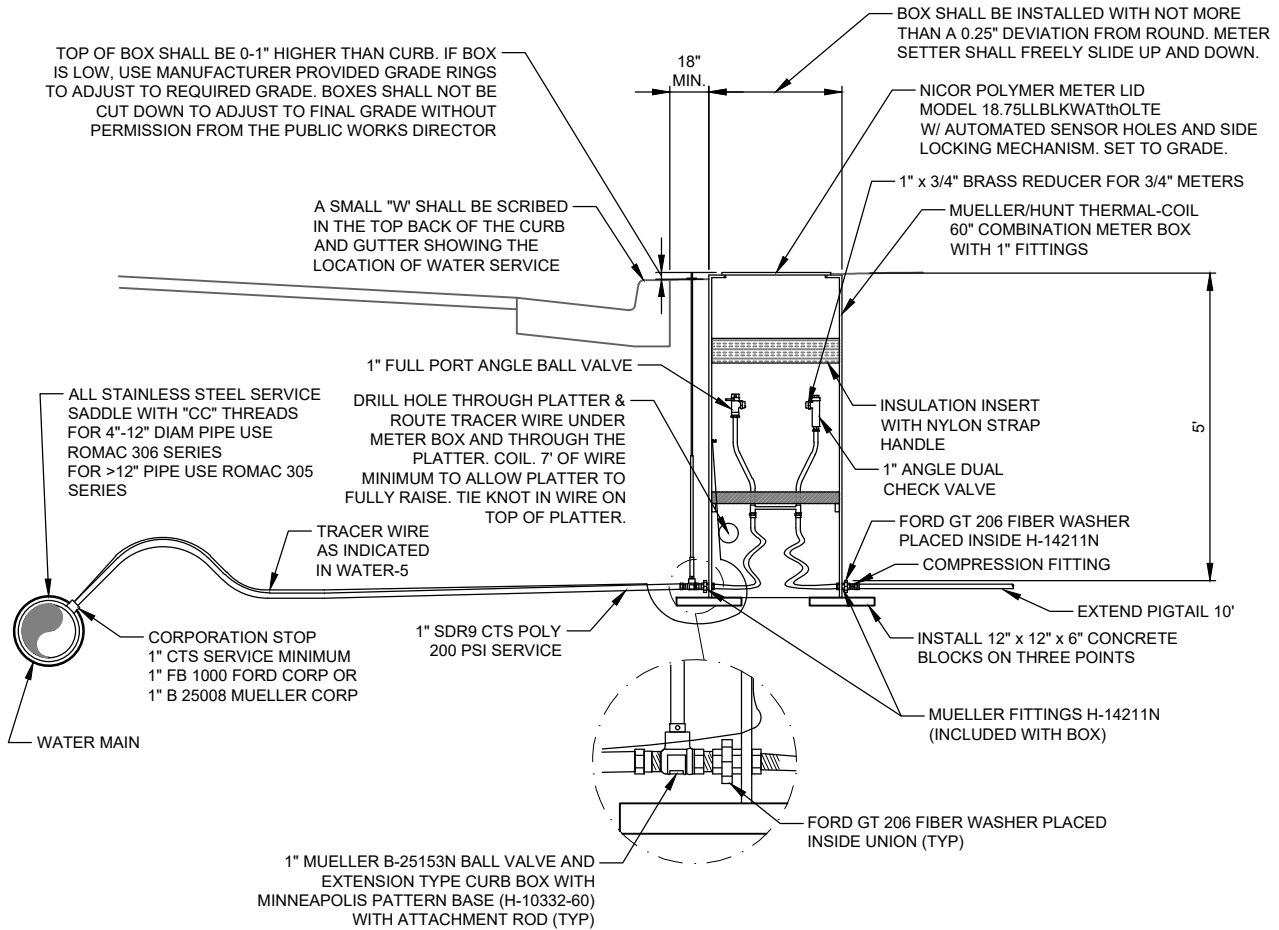


NOTES:

- METER BOX, COVER, COPPER SETTER, CORPORATION STOP, & SERVICE LINES TO BE FURNISHED AND INSTALLED BY DEVELOPER AND CONFORM TO AWWA C800.
- STAINLESS STEEL STIFFENERS ON ALL POLY CONNECTIONS.
- METER BOXES ARE ALLOWED WITHIN DRIVEWAY ZONE ONLY WITH PRIOR APPROVAL FROM PUBLIC WORKS DIRECTOR.
- WATER METER WILL BE INSTALLED BY HEBER CITY.
- SEE UTILS-3 FOR PLAN VIEW.
- WATER METER CAN TO BE LOCATED IN THE MIDDLE OF THE PLANTER STRIP OR BETWEEN SIDEWALK AND PROPERTY LINE (FOR COMBINATION SIDEWALK) OR AS DIRECTED BY ENGINEER.
- WATER SERVICE SHOULD CONNECT DIRECTLY TO THE MAIN LINE AND NOT "TEE" OFF FIRE HYDRANT LINE OR SERVICE LINES.
- WATER METER CAN SHALL BE COMPLETELY BACKFILLED WITH COMPACTED 3" MINUS GRANULAR MATERIAL FROM TOP TO BOTTOM.
- ANY NIPPLES USED FOR SERVICE SHALL BE STAINLESS STEEL.
- METER FEE WILL BE ASSESSED WITH BUILDING PERMIT OR AT TIME OF METER INSTALLATION.

WATER SERVICE - SINGLE LOTS

V:\ENGR\Stus\StusSpec\StusDwg\Files\WATER-6B.dwg - Service 1 Lot - 8/11/2021 12:47pm, rfrnk

DATE:	JUNE 2021
SCALE:	N.T.S.
75 NORTH MAIN STREET HEBER CITY, UTAH 84032 (435) 654-0757	



HEBER CITY
WATER-6B